


# Forced Air System (Down Draft Furnace)

Thermostatic  
Mixing Valve

This horizontal assembly  
must not exceed a height  
of 4 inches above top  
of water heater.

Water-to-Water  
Heat Exchanger

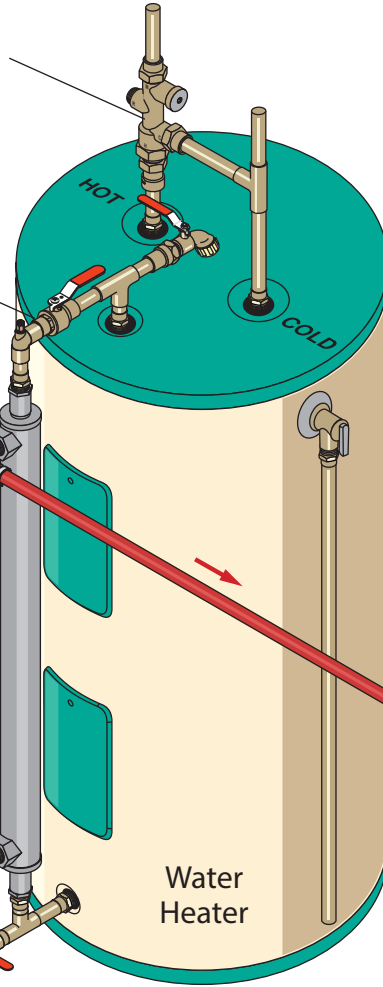

Hot Supply from Pump  
on Outdoor Furnace

Return to Outdoor Furnace

**NOTE**  
Installer must comply with all applicable  
codes and regulations.

Hot Supply

Heat Exchanger with  
90-degree fittings

Unit (A)

Main (C)

Bypass (B)

1" Central PEX®

For illustration purposes only,  
water heater styles may vary.

