


# Standard Heat Pump

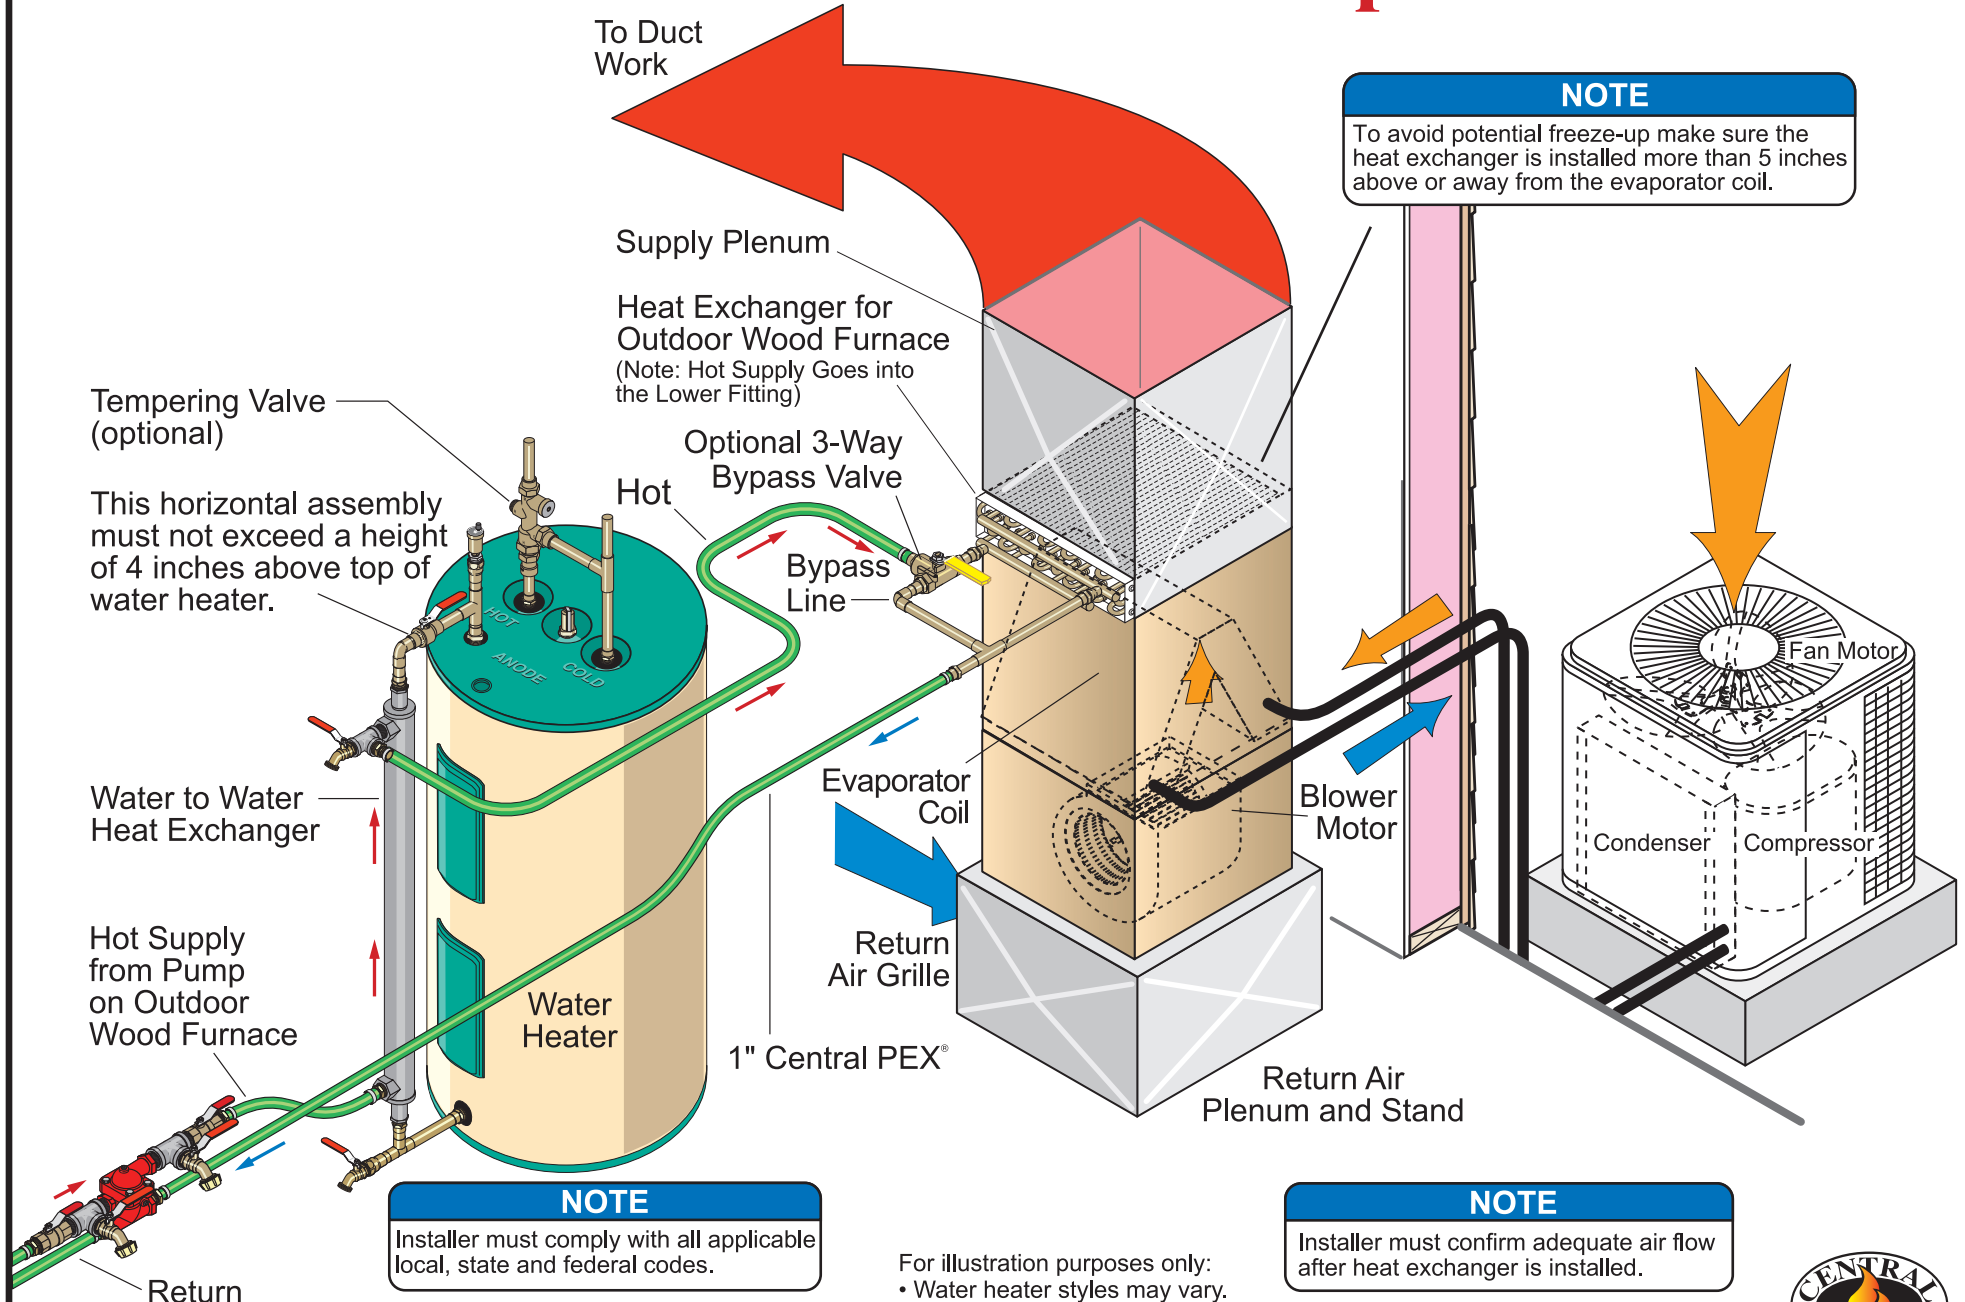

**NOTE**  
To avoid potential freeze-up make sure the heat exchanger is installed more than 5 inches above or away from the evaporator coil.

**NOTE**  
Installer must comply with all applicable local, state and federal codes.

For illustration purposes only:  
• Water heater styles may vary.  
• Applications may vary.

**NOTE**  
Installer must confirm adequate air flow after heat exchanger is installed.

