Existing Boiler - Pressurized
(with Wraparound Pump)

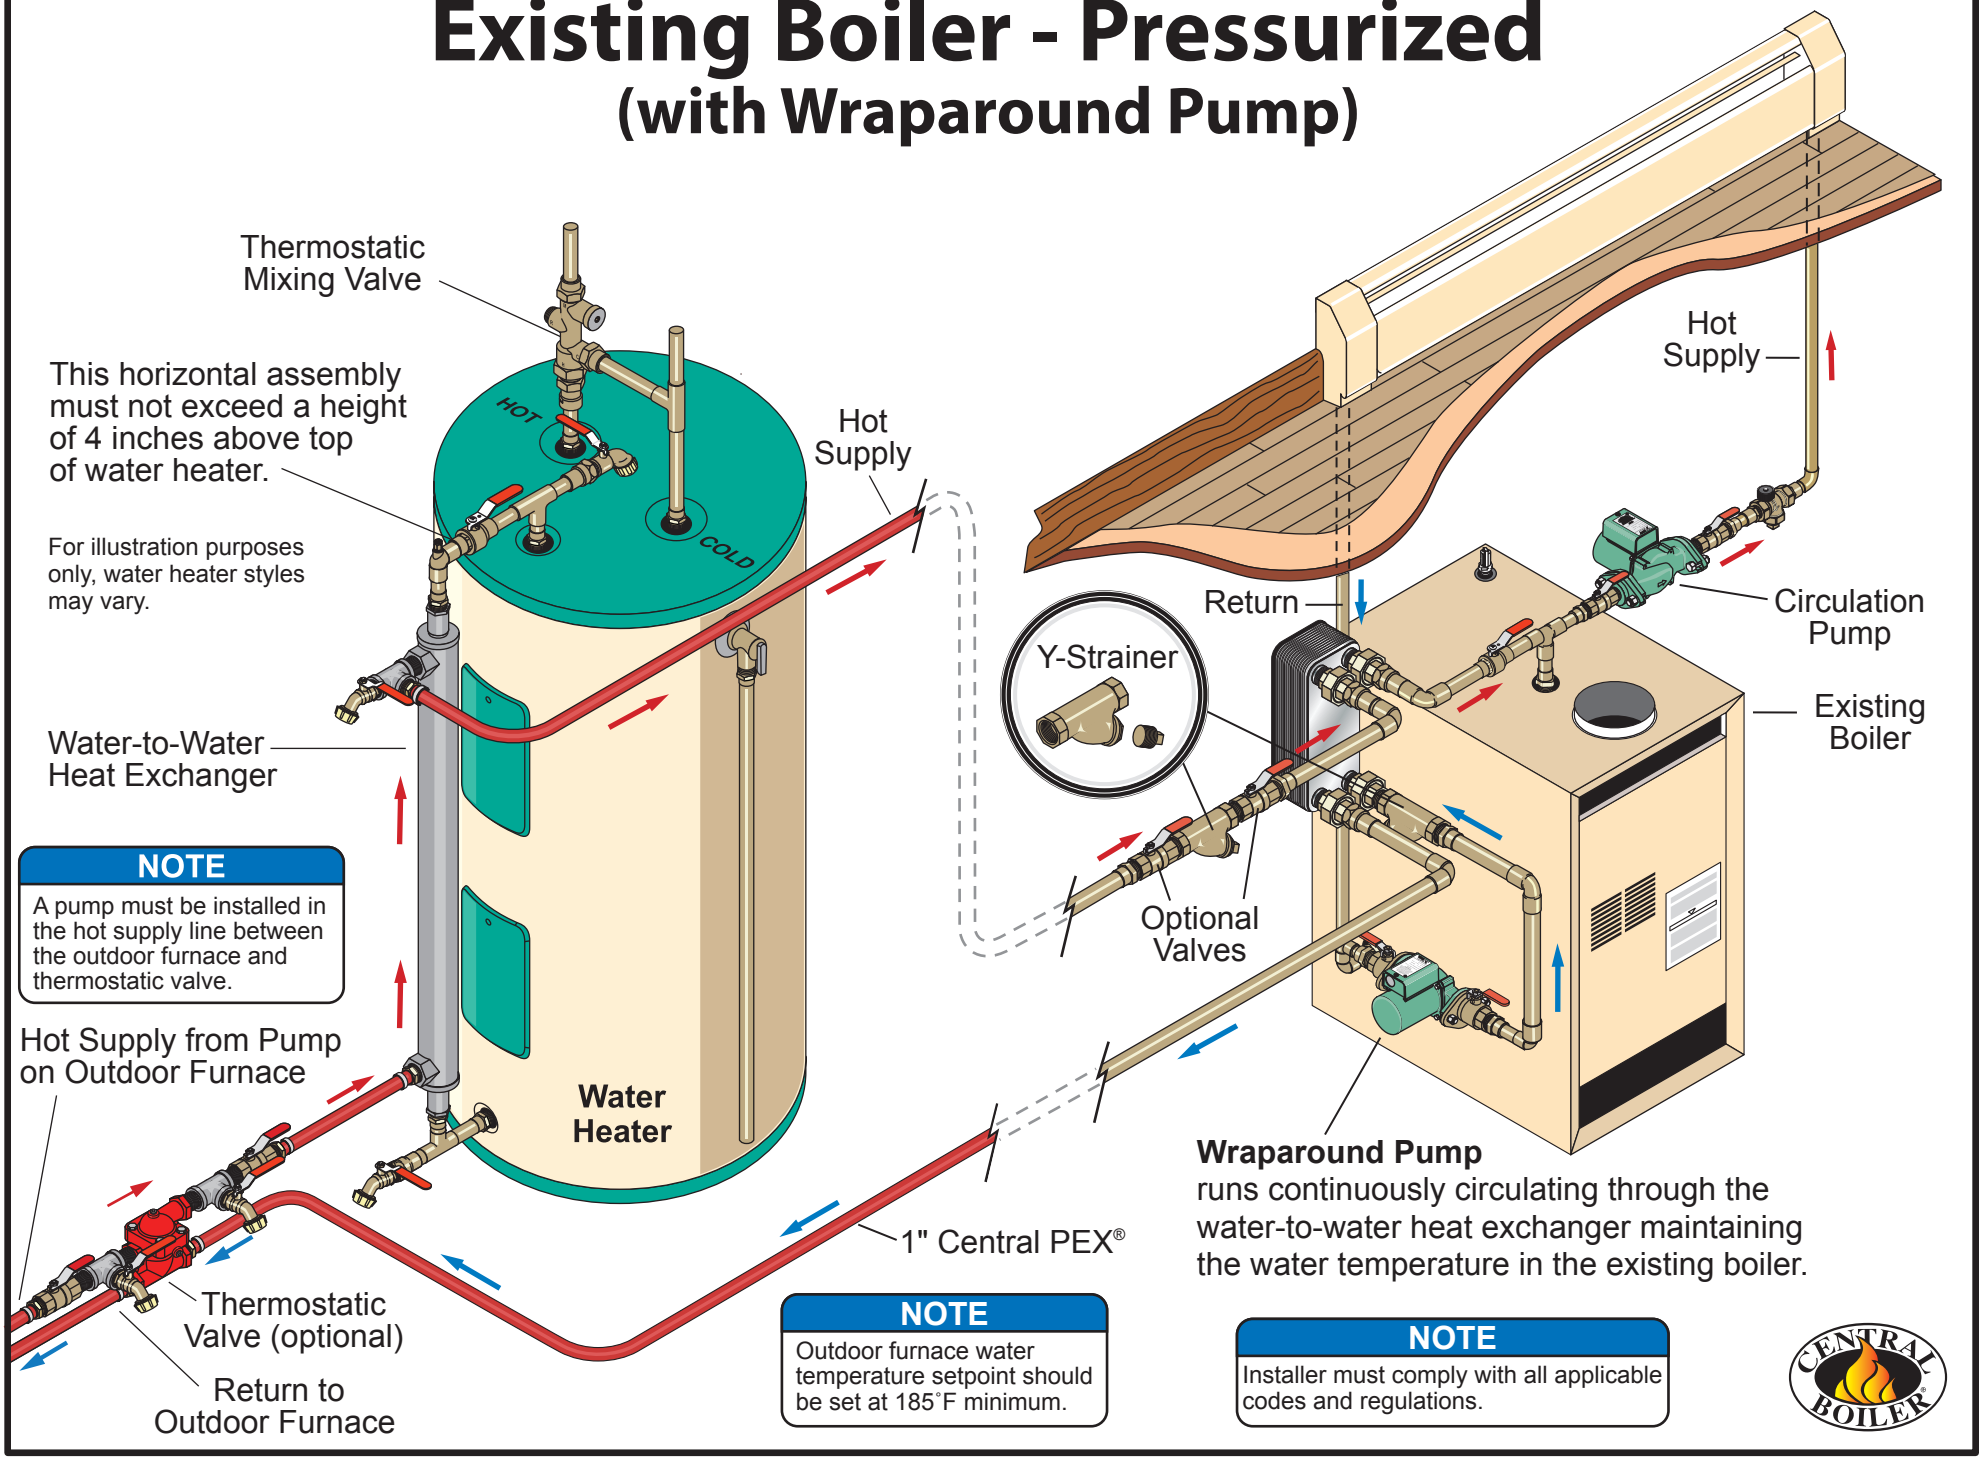

NOTE

A pump must be installed in the hot supply line between the outdoor furnace and thermostatic valve.

NOTE

Outdoor furnace water temperature setpoint should be set at 185˚F minimum.

NOTE

Installer must comply with all applicable codes and regulations.