

Multi Zone In-Floor

Hot Supply from Pump on
Outdoor Furnace

Thermostatic Valve
(Optional)

Return to Outdoor Furnace

1" Copper Piping

TO: 120 VAC POWER

CIRCULATOR

p/n 8200008

24-Volt Thermostat

NOTE

Installer must comply with all applicable codes and regulations.


NOTE

Outdoor furnace water temperature setpoint should be set at 185°F minimum.

NOTE

A pump must be installed in the hot supply line between the outdoor furnace and thermostatic valve.

Heating Upper Level

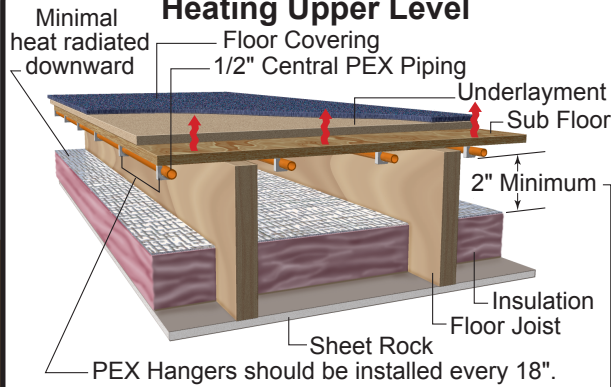

It is recommended that you maintain a 2" cavity between piping and insulation for best performance.

1/2" Central PEX® Piping is spaced 6" from outside wall. Remaining piping is spaced 12" on center.

Insulation

Slab

Insulation
Poly Vapor Barrier

