


Existing Boiler (Direct Plumbed) Depressurized

NOTE

Installer must comply with all applicable codes and regulations.

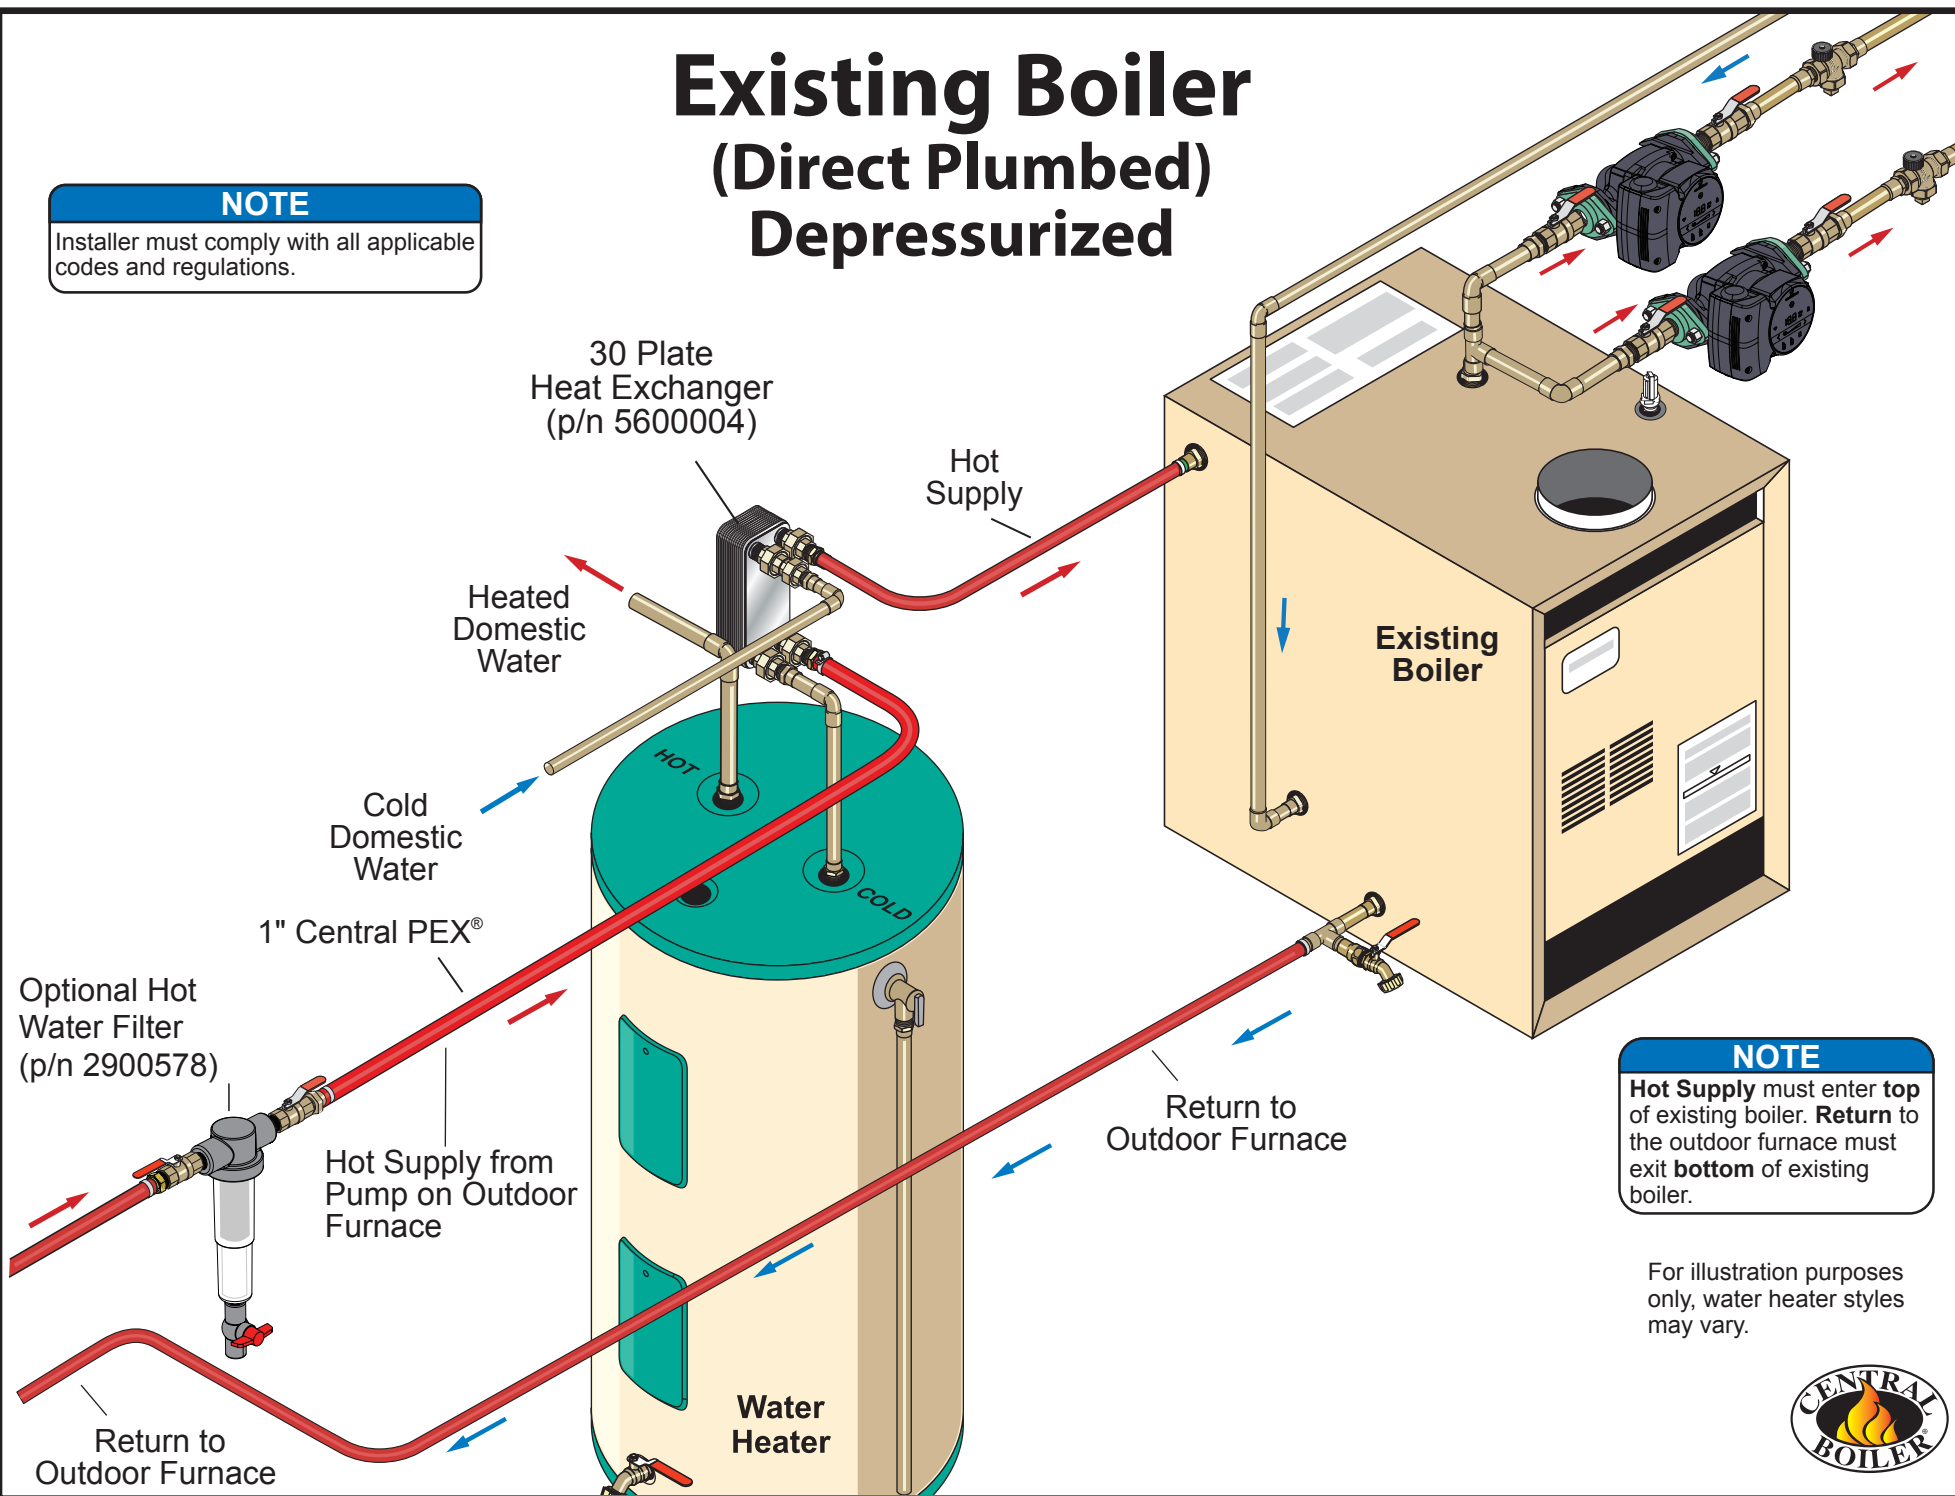

NOTE

Hot Supply must enter top of existing boiler. Return to the outdoor furnace must exit bottom of existing boiler.

For illustration purposes only, water heater styles may vary.

