
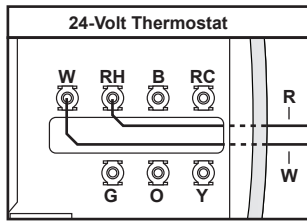



# Multi Zone In-Floor

**NOTE**

ON / OFF switch must be in the "ON" position for this install.

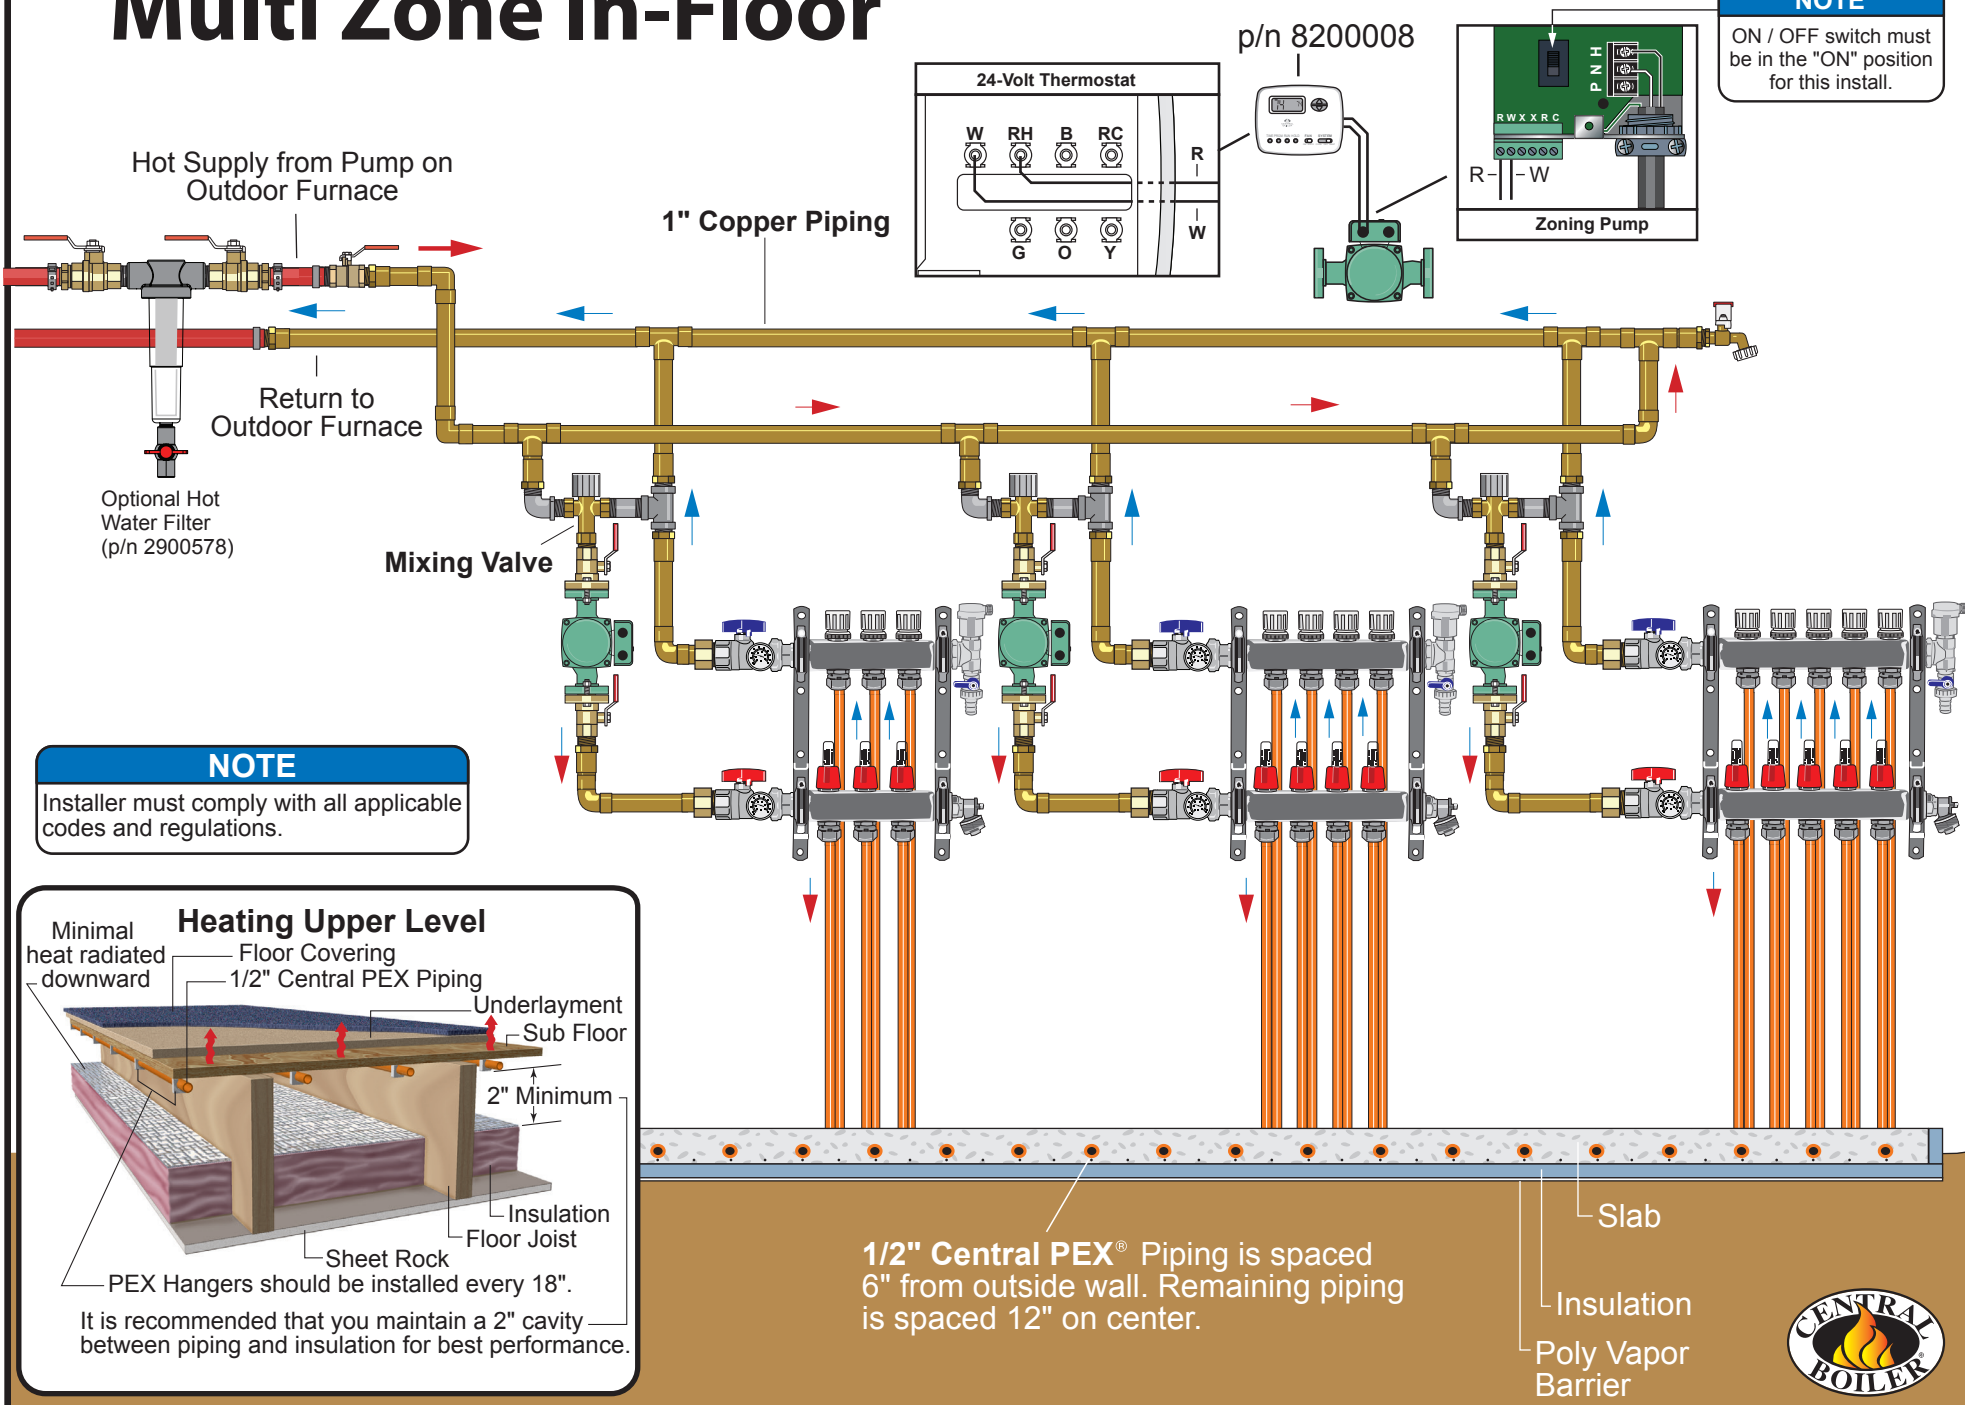

p/n 8200008



Hot Supply from Pump on Outdoor Furnace


Return to Outdoor Furnace

1" Copper Piping

Optional Hot Water Filter (p/n 2900578)

Mixing Valve

**NOTE**  
Installer must comply with all applicable codes and regulations.

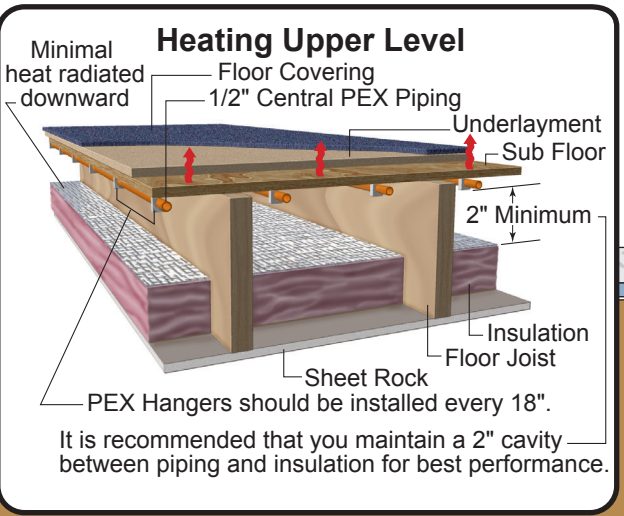

1/2" Central PEX® Piping is spaced 6" from outside wall. Remaining piping is spaced 12" on center.

Slab

Insulation

Poly Vapor Barrier

